
DSCA33-06 & DSCA33-07

Wiring Diagram

WARNING

THE ENCLOSED JUMPERS MUST BE INSTALLED IN THE INPUT TERMINAL BLOCK AS SHOWN BELOW IN ORDER TO PREVENT INTERNAL DAMAGE TO THE MODULE.

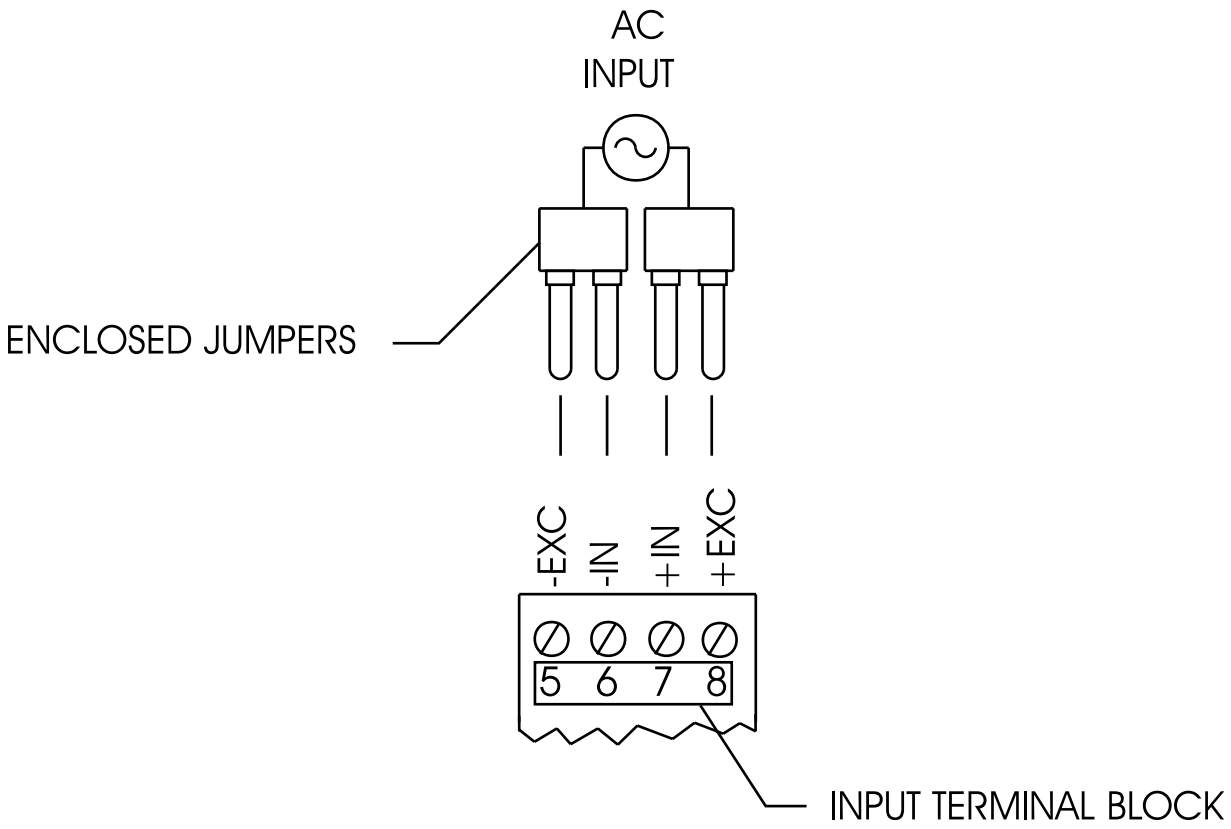

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000